



Kiwa Ltd.
 Unit 5 Prime Park Way
 Prime Enterprise Park
 Derby
 DE1 3QB
 T: +44 (0)1332 383333
 E: uk.bpenquiries@kiwa.com
 W: www.kiwa.co.uk/bda

BAR-19-113-P-A-UK
BDA Agrément®
SuperQuilt
Thermal Insulation Layer
(Pitched Roof Applications)

YBS Insulation Ltd.
 Unit 1 Crags Industrial Park
 Morven Street
 Creswell
 Derbyshire
 S80 4AJ
 T: +44 (0)1909 721662
 E: technical@ybsinsulation.com
 W: www.ybsinsulation.com

SCOPE OF AGRÉMENT

This Agrément relates to SuperQuilt (hereinafter the 'Product'). The Product is for use as a flexible thermal insulation layer used in conjunction with additional insulation materials or on its own. The Product can be installed above and/or below timber rafters in tiled or slated insulated pitched timber roofs where the ceiling lining follows the pitch of the roof. When installed below rafters and with overlaps sealed using YBS Foil Tape, the Product will perform as a vapour control layer (hereinafter 'VCL'). The Product can be used in new or existing domestic buildings, and non-domestic buildings with similar temperature and humidity conditions.

PRODUCT DESCRIPTION

The Product is a multi-foil insulation blanket consisting of 19 layers. The layers include polyester fibre wadding, separated by expanded polyethylene (PE) closed cell foam, and aluminium foil coated polyethylene terephthalate (PET) film layers. The Product is faced with aluminium foil laminate with polyethylene backing and reinforcing glass-fibre scrim (Foil-Tec Single). The Product is manufactured in accordance with the requirements of BS EN 13984 (Product Type A) and Draft BS EN 16863. For use with YBS Foil Tape to seal joints and penetrations of the Product.

PRODUCT ILLUSTRATION



THIRD-PARTY ACCEPTANCE

NHBC - for detailed information see section 3.3 (Third-Party Acceptance).

STATEMENT

It is the opinion of Kiwa Ltd., that the Product is fit for its intended use, provided it is specified, installed and used in accordance with this Agrément.

Chris Vurley, CEng
 Technical Manager, Building Products

Mark Crowther, M.A. (Oxon)
 Kiwa Ltd. Technical Director

SUMMARY OF AGRÉMENT

This document provides independent information to specifiers, building control personnel, contractors, installers and other construction industry professionals considering the fitness for the intended use of the Product. This Agrément covers the following:

- Conditions of use;
- Production Control, Quality Management System and the Annual Verification procedure;
- Product components and ancillary items, points of attention for the Specifier and examples of details;
- Installation;
- Independently assessed Product characteristics and other information;
- Compliance with national Building Regulations, other regulatory requirements and Third-Party Acceptance, as appropriate;
- Sources.

MAJOR POINTS OF ASSESSMENT

Moisture Control - the Product can contribute to limiting the risk of interstitial and surface condensation (see section 2.2.9).

Fire Performance - the Product is classified as European Classification E* (combustible), in accordance with BS EN 13501-1 (see section 2.2.10).

Thermal Performance - the Product increases the thermal insulation of a pitched roof structure (see section 2.2.11).

Durability - the Product will have a service life durability equivalent to that of the structure into which it is incorporated (see section 2.2.12).

CE Marking - the Agrément holder has responsibility for CE marking in accordance with all relevant harmonised European Product Standards. An asterisk (*) appearing in this Agrément indicates value included in the Declaration of Performance (DoP) (see section 2.2.13).

CONTENTS

Chapter 1 - General considerations

- 1.1 - Conditions of use
- 1.2 - Production Control and Quality Management System
- 1.3 - Annual verification procedure - continuous surveillance

Chapter 2 - Technical assessment

- 2.1 - Product components and ancillary items
- 2.2 - Points of attention to the Specifier
- 2.3 - Examples of details
- 2.4 - Installation
- 2.5 - Independently assessed Product characteristics

Chapter 3 - CDM, national Building Regulations and Third-Party Acceptance

- 3.1 - The Construction (Design and Management) Regulations 2015 and The Construction (Design and Management) Regulations (Northern Ireland) 2016
- 3.2 - The national Building Regulations
- 3.3 - Third-Party Acceptance

Chapter 4 - Sources

Chapter 5 - Amendment history

CHAPTER 1 - GENERAL CONSIDERATIONS

1.1 - CONDITIONS OF USE

1.1.1 Design considerations

See section 2.1.

1.1.2 Application

The assessment of the Product relates to its use in accordance with this Agrément and the Agrément holder's requirements.

1.1.3 Assessment

Kiwa Ltd. has assessed the Product in combination with relevant test reports, technical literature, the Agrément holder's quality plan, DoPs and site visit as appropriate. The NHBC Standards have also been taken into consideration.

1.1.4 Installation supervision

The quality of installation and workmanship must be controlled by a competent person who must be an employee of the installation company.

The Product must be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

1.1.5 Geographical scope

The validity of this document is limited to England, Wales, Scotland and Northern Ireland, with due regard to chapter 3 of this Agrément (CDM, national Building Regulations and Third-Party Acceptance).

1.1.6 Validity

The purpose of this BDA Agrément® is to provide for well-founded confidence to apply the Product within the Scope described. The validity of this Agrément is three years after the issue date, and as published on www.kiwa.co.uk/bda.

1.2 - PRODUCTION CONTROL AND QUALITY MANAGEMENT SYSTEM

Kiwa Ltd. has determined that the Agrément holder fulfils all obligations in relation to this Agrément, in respect of the Product.

The initial audit demonstrated that the Agrément holder has a satisfactory Quality Management System (QMS) and is committed to continuously improving their quality plan. Document control and record keeping procedures were deemed satisfactory. A detailed Production Quality Specification (PQS) has been compiled to ensure traceability and compliance under the terms of this Agrément.

1.3 - ANNUAL VERIFICATION PROCEDURE - CONTINUOUS SURVEILLANCE

To demonstrate that the Product is in conformity with the requirements of the technical specification described in this Agrément, an Annual Verification procedure has been agreed with the Agrément holder in respect of continuous surveillance and assessment, and auditing of the Agrément holder's QMS.

This Agrément does not constitute a design guide for the Product. It is intended as an assessment of fitness for purpose only.

2.1 - PRODUCT COMPONENTS AND ANCILLARY ITEMS

2.1.1 Product components included within the scope of this Agrément

The following components are integral to the use of the Product:

Item	Description	Dimensions
SuperQuilt	multi-foil thermal insulation and VCL	1.5 m wide by 10 m long by 40 mm (mean) thick providing 15 m ² coverage
		1.5 m wide by 5 m long by 40 mm (mean) thick providing 7.5 m ² coverage
		1.5 m wide by 2.4 m long by 40 mm (mean) thick providing 3.6 m ² coverage
		1.2 m wide by 10 m long by 40 mm (mean) thick providing 12 m ² coverage
		800 g/m ² (mean) weight
YBS Foil Tape	aluminium foil-backed acrylic self-adhesive tape	75 mm wide by 50 m long rolls

2.1.2 Ancillary items falling outside the scope of this Agrément

Ancillary items detailed in this section may be used in conjunction with the Product but fall outside the scope of this Agrément:

- staples or nails - stainless steel or galvanised steel, minimum 14 mm long;
- breather membrane;
- counter battens - pre-treated timber counter battens;
- additional insulation - including glass mineral wool (GMW); expanded polystyrene (EPS); extruded polystyrene (XPS); polyisocyanurate (PIR); phenolic; sheep's wool; or polyester fibre insulation (YBS Non-Itch);
- roof void vents - plastic vents to provide cavity ventilation.

2.2 - POINTS OF ATTENTION TO THE SPECIFIER

2.2.1 Design responsibility

A Specifier may undertake a project specific design in which case it is recommended that the Specifier co-operates closely with the Agrément holder. The Specifier or installing contractor is responsible for the final as-built design.

2.2.2 Applied building physics (heat, air, moisture)

The physical behaviour of the building incorporating the Product shall be verified as suitable by a competent specialist, who can be either a qualified employee of the Agrément holder or a qualified consultant. The Specialist will check the physical behaviour of the building design and if necessary, can offer advice in respect of improvements to achieve the final specification. It is recommended that the Specialist co-operates closely with the Agrément holder.

2.2.3 General design considerations

The uncompressed Product is most thermally effective with a minimum 13 mm non-ventilated air cavity (formed using timber battens or structural timbers (rafters)) on both sides of the Product.

Roof design considerations

Existing pitched timber roofs shall be structurally sound, be in a good state of repair, and free from any damp or mould.

New pitched timber roofs shall be designed and constructed in accordance with the national Building Regulations to prevent moisture penetration and air infiltration.

Insulation batts or boards in a pitched roof void shall meet the U-value requirement of the national Building Regulations.

The junction between a roof and wall shall be fire stopped. The minimum period of fire resistance of roof/wall junctions shall be maintained in accordance with the provisions of the national Building Regulations.

Account should be taken of:

- Government Accredited Construction Details for Part L - Timber Frame Illustrations in England and Wales;
- Accredited Construction Details for Scotland;
- PAS 2030; and
- PAS 2035.

Guidance on linear thermal transmittance, heat flows and surface temperatures can be found in the documents supporting the national Building Regulations and BS EN ISO 10211, BRE Information Paper IP1/06, BRE Report 262 and BRE Report 497.

Thermal transmittance (U-value) calculations of specific pitched roof constructions incorporating the Product should be carried out in accordance with BS EN ISO 6946, BS EN ISO 10211, BRE Report 443. Design thermal values can be found in BS EN ISO 10456.

The requirement for limiting heat loss through a pitched roof, including the effect of thermal bridging, can be satisfied if the U-value of a pitched roof incorporating the Product does not exceed the target U-value requirement in the national Building Regulations.

The design and construction of junctions with walls and openings shall minimise air infiltration and thermal bridging. To minimise the effect of thermal bridging cross-battening is advised.

A breather membrane shall be installed on the counter battens outside of the insulation.

Habitable room in roof space and roof void ventilation along the eaves and the ridge shall be in accordance with BS 5250. Care shall be taken to provide adequate trickle ventilation, particularly in rooms expected to experience high humidity.

To mitigate the risk of condensation forming on the underside of the Product it may be necessary to ensure the provision of ventilated voids between the Product and additional insulation in accordance with BS 5250 Annex H.

Any ventilation openings shall be sufficiently small or suitably protected by mesh to prevent the ingress of birds and small animals.

Any openings or penetrations in a vaulted ceiling lining and ceiling-wall joints shall be well sealed to avoid condensation around the Product.

Product considerations

The Product can be cut using a sharp pair of scissors or craft knife.

The Product shall be cut to fit around openings or connections; gaps shall be minimised and any exposed cut edges shall be sealed using YBS Foil tape.

Penetration of the Product by services shall be kept to a minimum and shall be sealed using YBS Foil Tape.

For over rafter applications, sarking board and shingles or tile battens and tiles/slates shall be installed immediately after installation of the Product to protect it from rain in accordance with BS 5534.

When installed above rafters, a VCL should be installed in conjunction with a suitable breather membrane under the tiles, without a ventilated air space.

When installed below rafters, the Product will perform as a VCL and should be used in conjunction with a suitable breather membrane under the tiles, without a ventilated air space.

When installed below rafters, installation of the Product is to be left until the finished roof covering is in place and any flue pipe openings are sealed.

At openings in a roof structure e.g. rooflights, the Product shall be supported by battens around the opening.

Where a vaulted plasterboard ceiling lining is installed to encapsulate the Product, it shall be designed and installed in accordance with BS 8212.

The Product shall be:

- suitably separated or shielded from any potential source of ignition during installation and once incorporated in a pitched roof build-up;
- separated from any heat-producing chimney, ductwork or flue pipe penetrations of a pitched roof, as recommended in the supporting documents to the national Building Regulations, and shall not be in contact with heat sources greater than 80 °C.

2.2.4 Project specific design considerations

No pre-installation survey is required for the installation of the Product.

Due consideration shall be given to the need to conduct a condensation risk analysis in accordance with BS 5250 Annex H.

2.2.5 Permitted applications

Only applications designed according to the specifications given in this Agrément are permitted; in each case the Specifier will have to co-operate closely with the Agrément holder.

2.2.6 Installer competence level

The Product must be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

Installation can be undertaken by competent persons experienced in this sort of work.

2.2.7 Delivery, storage and site handling

The Product is delivered to site in suitable packaging, that bears the Product name, the Agrément holder's name and the BDA Agrément® logo incorporating the number of this Agrément.

Store the Product in accordance with the Agrément holder's requirements. Particular care must be taken to:

- avoid exposure to direct sunlight for extended periods of time;
- avoid exposure to high or low temperatures for extended periods of time;
- store in a well-ventilated covered area to protect from rain, frost and humidity;
- store away from possible ignition sources;
- store in clean dry conditions;
- protect from being dropped or crushed;
- store away from flammable material, organic solvents and plasticisers;
- protect from mud and dirt.

For longer term protection on-site, the Product should be stored indoors.

Contaminated or wet Product shall not be used.

2.2.8 Maintenance and repair

Once installed, the Product does not require maintenance. The external pitched roof finish shall be maintained in a weathertight condition.

Holes in the Product shall be repaired using YBS Foil Tape. For advice in respect of repair, consult the Agrément holder.

Performance factors in relation to the Major Points of Assessment

2.2.9 Moisture control

Condensation risk

Pitched timber roofs incorporating the Product can adequately limit the risk of interstitial and surface condensation when designed and constructed in accordance with BS 5250 and BRE Report 262.

The Product will perform as a VCL when installed with overlaps sealed using YBS Foil Tape.

2.2.10 Fire performance

The Product is classified as European Classification E* (combustible), in accordance with BS EN 13501-1.

The Product has a low rate of heat release and a low rate of fire growth when ignited. The Product will melt and shrink away from heat.

When the Product is:

- left exposed, it may contribute to an existing fire hazard;
- contained within a roof void, it will not contribute to the development stages of a fire or present a smoke or toxic hazard.

The Product does not:

- prejudice the fire resistance of a pitched roof;
- affect the external fire exposure classification obtained by tiled or slated roofs in accordance with BS 476-3.

2.2.11 Thermal performance

The Product has a low hemispherical emissivity surface, in accordance with BS EN 16012 Annex D.

The thermal resistance of the Product has been declared in accordance with BS EN 16012 and BS EN 12667.

The Product acts by creating a low emissivity surface in a roof, thus reflecting heat back into a building.

The Product is effective:

- in improving the thermal insulation of pitched timber roofs and helps to reduce energy transfer by conduction, convection and radiation;
- in winter by reflecting heat back into a building;
- in summer by providing an effective barrier to solar over-heating.

The Product reduces air leakage when joints are sealed using YBS Foil Tape.

2.2.12 Durability

The Product will have a service life durability equivalent to that of the structure into which it is incorporated.

The expected lifespan of the building itself should be at least 60 years.

The Product is coated with nitrocellulose to provide a corrosion-resistant surface.

The Product is stable, rot-proof, non-hygroscopic, water-resistant, inert, non-toxic, does not sustain vermin or insects and will not encourage the growth of fungi or mould.

Once installed, the Product is protected in service from agents liable to cause deterioration.

2.2.13 CE Marking

The harmonised European standards for the Product are Draft BS EN 16863 and BS EN 13984.

2.3 - EXAMPLES OF TYPICAL DETAILS

Diagram 1 - single layer - under rafters

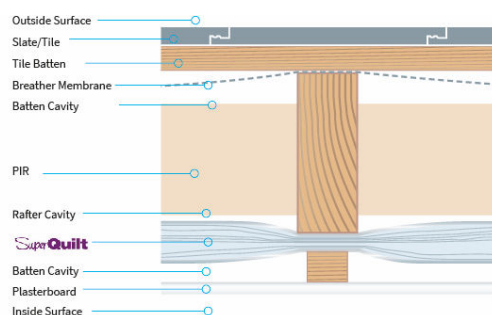


Diagram 2 - single layer - under rafters with BreatherQuilt


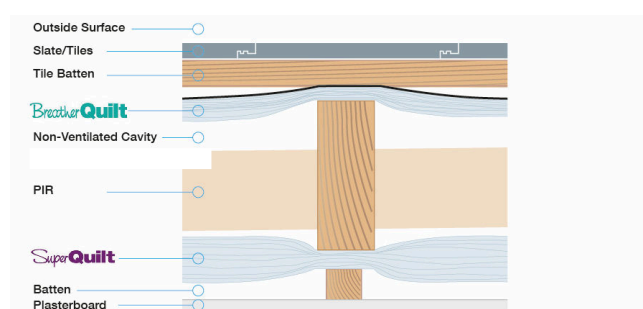


Diagram 3 - single layer - over rafters

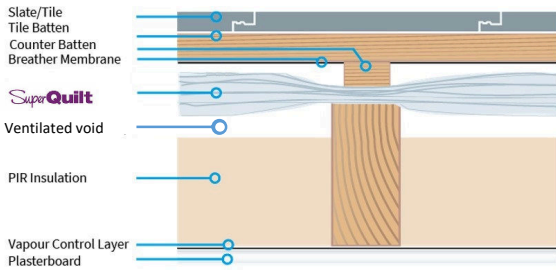

2.4 - INSTALLATION

The Product must be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

2.4.1 Installer competence level

See section 2.2.6.

2.4.2 Delivery, storage and site handling

See section 2.2.7.

2.4.3 Project specific installation considerations

No pre-installation survey is required for the installation of the Product.

2.4.4 Preparation

The following factors shall be considered prior to the commencement of work:

- ensure that sufficient material is available for the planned work.

2.4.5 Outline installation procedure

The key sequence for installation is:

- install the Product perpendicular to the rafters, directly from the roll;
- start from external wall and fix it using staples, nails or saddle clips;
- cut the Product equal to the width of the roof section plus 100 mm;
- overlap the Product at each joint by approximately 50 mm and fix onto the rafters (the joints shall be sealed using YBS Foil Tape);
- at the eaves, cut the Product around the rafters and seal to cavity wall insulation or wall plate.

2.4.6 Finishing

There is no finishing required to the Product upon completion of the installation.

2.5 - INDEPENDENTLY ASSESSED PRODUCT CHARACTERISTICS

2.5.1 Moisture control

Test	Result
Water vapour transmission resistance	1569 MNs/g*
Water vapour diffusion-equivalent air layer thickness (Sd)	313.8 m

2.5.2 Strength

Test	Result	
Tensile strength parallel to faces, in accordance with BS EN 1608	142 kPa*	
Resistance to tearing (nail shank), in accordance with BS EN 12310-1	Length	406 N*
	Width	411 N*
Dimensional stability under specified temperature and humidity, in accordance with BS EN 1604	Length	1.5 %
	Width	2.3 %

2.5.3 Fire performance

Test	Result
Reaction to fire classification, in accordance with BS EN 13501-1	E* (combustible)

2.5.4 Thermal performance

Test	Result	
Hemispherical emissivity coefficient of foil outer faces, in accordance with BS EN 16012 Annex D	0.02*	
Thermal resistance of Product core, in accordance with BS EN 16012 method B and BS EN 12667	1.52 m ² K/W*	
Thermal conductivity, in accordance with BS EN 16012	0.0283 W/mK	
Thermal resistance of Product compressed core, in accordance with BS EN 12667	7 mm thickness	0.23 m ² K/W
	14 mm thickness	0.47 m ² K/W
Calculated thermal resistance, in accordance with BS EN ISO 6946	Product with adjacent minimum 13 mm non-ventilated cavities, vertical heat flow	2.5 m ² K/W*
	Two layers of Product with three minimum 13 mm non-ventilated cavities, vertical heat flow	4.51 m ² K/W*

CHAPTER 3 - CDM, NATIONAL BUILDING REGULATIONS AND THIRD-PARTY ACCEPTANCE

3.1 - THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS 2015 AND THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS (NORTHERN IRELAND) 2016

Information in this Agrément may assist the client, Principal Designer/CDM co-ordinator, designer and contractors to address their obligations under these Regulations.

3.2 - THE NATIONAL BUILDING REGULATIONS

In the opinion of Kiwa Ltd., the Product, if installed and used in accordance with Chapter 2 of this Agrément, can satisfy or contribute to satisfying the relevant requirements of the following national Building Regulations.

3.2.1 - ENGLAND THE BUILDING REGULATIONS 2010 AND SUBSEQUENT AMENDMENTS

- C2(b) Resistance to moisture - the Product can contribute to satisfying this Regulation
- C2(c) Resistance to moisture - the Product can contribute to limiting the risk of surface and interstitial condensation, if a pitched roof is designed and constructed in accordance with this Agrément
- J4 Protection of the building - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- L1(a)(b) Conservation of fuel and power - the Product can contribute to satisfying this Requirement
- Regulation 7 Materials and workmanship - the Product is manufactured from suitably safe and durable materials for its application and can be installed to give satisfactory performance
- Regulation 23 Requirements relating to thermal elements - the use of the Product can contribute to the conservation of fuel and power in buildings by limiting heat gains and losses through pitched roofs
- Regulation 25 Minimum energy performance Requirements for new buildings - the Product can contribute to the target CO₂ emission rates
- Regulation 26 CO₂ emission rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26A Fabric energy efficiency rates for new buildings - the Product can contribute to satisfying this Regulation

3.2.2 - WALES THE BUILDING REGULATIONS 2010 AND SUBSEQUENT AMENDMENTS

- C2(b) Resistance to moisture - the Product can contribute to satisfying this Regulation
- C2(c) Resistance to moisture - the Product can contribute to limiting the risk of surface and interstitial condensation, if a pitched roof is designed and constructed in accordance with this Agrément
- J4 Protection of the building - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- L1(a)(b) Conservation of fuel and power - the Product can contribute to satisfying this Requirement
- Regulation 7 Materials and workmanship - the Product is manufactured from suitably safe and durable materials for its application and can be installed to give satisfactory performance
- Regulation 23 Requirements relating to thermal elements - the use of the Product can contribute to the conservation of fuel and power in buildings by limiting heat gains and losses through pitched roofs
- Regulation 25 Minimum energy performance Requirements for new buildings - the Product can contribute to the target CO₂ emission rates
- Regulation 26 CO₂ emission rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26A Primary energy consumption rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26B Fabric performance values for new dwellings - the Product can contribute to satisfying this Regulation

3.2.3 - SCOTLAND THE BUILDING (SCOTLAND) REGULATIONS 2004 AND SUBSEQUENT AMENDMENTS

3.2.3.1 Regulations 8 (1)(2) Durability, workmanship and fitness of materials

- the Product is manufactured from acceptable materials and is adequately resistant to deterioration and wear under normal service conditions, provided it is installed in accordance with the requirements of this Agrément

3.2.3.2 Regulation 9 Building Standards - Construction

- 2.3 Structural protection - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- 3.10 Precipitation - the Product can protect a pitched roof from precipitation penetrating to inner face
- 3.15 Condensation - the pitched roof using the Product in accordance with the Requirements of this Agrément, can be designed and constructed to comply with these Standards
- 3.19 Combustion appliances - relationship to combustible materials - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- 6.1(b) Carbon dioxide emissions - the Product can contribute to satisfying this Requirement
- 6.2 Building insulation envelope - the Product can contribute to satisfying this Requirement
- 7.1(a)(b) Statement of sustainability - the Product can contribute to satisfying the relevant Requirements of Regulation 9, Standards 1 to 6, and therefore can contribute to a construction meeting a bronze level of sustainability as defined in this Standard; in addition, the Product can contribute to a construction meeting a higher level of sustainability as defined in this Standard

3.2.3.3 Regulation 12 Building Standards - Conversions

- all comments given under Regulation 9 also apply to this Regulation, with reference to Schedule 6 of the Building (Scotland) Regulations 2004 and subsequent amendments, clause 0.12 of the Technical Handbook (Domestic) and clause 0.12 of the Technical Handbook (Non-Domestic)

3.2.4 - NORTHERN IRELAND

THE BUILDING REGULATIONS (NORTHERN IRELAND) 2012 AND SUBSEQUENT AMENDMENTS

- 23(a)(i)(iii)(b) Fitness of materials and workmanship - the Product is manufactured from materials which are considered suitably safe and acceptable for use as thermal insulation
- 28(b) Resistance to the weather - the Product can protect a pitched roof from precipitation penetrating to the inner face
- 29 Condensation - the Product can contribute to limiting the risk of surface and interstitial condensation
- 39(a)(i) Conservation measures - the Product can contribute to limiting heat gains and losses through a pitched roof
- 40(2) Target carbon dioxide emission rates - a pitched roof incorporating the Product must be designed and constructed as not to exceed its target CO₂ emission rate
- 43 Renovation of thermal elements - the renovation work carried out can ensure that pitched roof complies with Requirement 39(a)(i)
- 73(1) Protection of people and buildings - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire

3.3 - THIRD-PARTY ACCEPTANCE

NHBC - In the opinion of Kiwa Ltd., the Product, if installed, used and maintained in accordance with this Agrément, can satisfy or contribute to satisfying the relevant requirements in relation to NHBC Standards, Chapter 7.2 Pitched roofs.

CHAPTER 4 - SOURCES

- BS EN ISO 6946:2017 Building components and building elements. Thermal resistance and thermal transmittance. Calculation methods
- BS EN ISO 10211:2017 Thermal bridges in building construction. Heat flows and surface temperatures. Detailed calculations
- BS EN ISO 10456:2007 Building materials and products. Hygrothermal properties. Tabulated design values and procedures for determining declared and design thermal values
- BS EN 1604:2013 Thermal insulating products for building applications. Determination of dimensional stability under specified temperature and humidity conditions
- BS EN 1608:2013 Thermal insulating products for building applications. Determination of tensile strength parallel to faces
- BS EN 12310-1:2000 Flexible sheets for waterproofing. Determination of resistance to tearing (nail shank). Bitumen sheets for roof waterproofing
- BS EN 12667:2001 Thermal performance of building materials and products. Determination of thermal resistance by means of guarded hot plate and heat flow meter methods. Products of high and medium thermal resistance
- BS EN 13501-1:2018 Fire classification of construction products and building elements. Classification using data from reaction to fire tests
- BS EN 13984:2013 Flexible sheets for waterproofing. Plastic and rubber vapour control layers. Definitions and characteristics
- BS EN 16012:2012+A1:2015 Thermal insulation for buildings. Reflective insulation products. Determination of the declared thermal performance
- Draft BS EN 16863 Thermal insulation products for buildings. Factory made reflective insulation products (RI). Specification
- BS 476-3:2004 Fire tests on building materials and structures. Classification and method of test for external fire exposure to roofs
- BS 5250:2011+A1:2016 Code of practice for control of condensation in buildings
- BS 5534:2014+A2:2018 Slating and tiling for pitched roofs and vertical cladding. Code of practice
- BS 8212:1995 Code of practice for dry lining and partitioning using gypsum plasterboard
- Accredited Construction Details (Scotland) - Part 3 Timber frame construction details:2015
- BBA Information No. 3:2016 Reflective foil insulation - Conventions for U-value calculations
- BRE Information Paper 1/06:2006 Assessing the effects of thermal bridging at junctions and around openings
- BRE Report 262:2002 Thermal insulation: avoiding risks
- BRE Report 443:2006 Conventions for U-value calculations
- BRE Report 497:2016 Conventions for calculating linear thermal transmittance and temperature factors
- Government Accredited Construction Details for Part L:2019
- NHBC Standards:2020
- PAS 2030:2019 Specification for the installation of energy efficiency measures in existing dwellings and insulation in residential park homes
- PAS 2035:2019 Retrofitting dwellings for improved energy efficiency. Specification and guidance

Remark: apart from these sources, technical information and confidential reports have been assessed; any relevant documents are in the possession of Kiwa Ltd. and kept in the Technical Assessment File of this Agrément. The Installation Manual for the Product may be subject to change, the Agrément holder should be contacted for clarification of revision.

CHAPTER 5 - AMENDMENT HISTORY

Revision	Amendment Description	Amended By	Approved By	Date
-	First issue	C Devine	C Vurley	August 2021



Kiwa Ltd.
 Unit 5 Prime Park Way
 Prime Enterprise Park
 Derby
 DE1 3QB
 T: +44 (0)1332 383333
 E: uk.bpenquiries@kiwa.com
 W: www.kiwa.co.uk/bda

BAR-18-025-P-A-UK
BDA Agrément®
SuperQuilt
Thermal Insulation Layer
(Flat Roof Applications)

YBS Insulation Ltd.
 Unit 1 Crags Industrial Park
 Morven Street
 Creswell
 Derbyshire
 S80 4AJ
 T: +44 (0)1909 721662
 E: technical@ybsinsulation.com
 W: www.ybsinsulation.com

SCOPE OF AGRÉMENT

This Agrément relates to SuperQuilt (hereinafter the 'Product'). The Product is for use in cold roof applications as a flexible thermal insulation layer used in conjunction with additional insulation materials or on its own. The Product can be installed above and/or below timber joists in flat timber roofs where the ceiling line is beneath a flat timber roof. When installed below joists and with overlaps sealed using YBS Foil Tape, the Product will perform as a vapour control layer (hereinafter 'VCL'). The Product can be used in new or existing domestic buildings, and non-domestic buildings with similar temperature and humidity conditions.

PRODUCT DESCRIPTION

The Product is a multi-foil insulation blanket consisting of 19 layers. The layers include polyester fibre wadding, expanded polyethylene (PE) closed cell foam, and aluminium foil coated polyethylene terephthalate (PET) film. The Product is faced with aluminium foil laminate with polyethylene backing and reinforcing glass-fibre scrim (Foil-Tec Single). The Product is manufactured in accordance with the requirements of BS EN 13984 (Product Type A) and Draft BS EN 16863. For use with YBS Foil Tape to seal joints and penetrations of the Product.

PRODUCT ILLUSTRATION



THIRD-PARTY ACCEPTANCE

NHBC - for detailed information see section 3.3 (Third-Party Acceptance).

STATEMENT

It is the opinion of Kiwa Ltd., that the Product is fit for its intended use, provided it is specified, installed and used in accordance with this Agrément.

Chris Vurley, CEng
 Technical Manager, Building Products

Mark Crowther, M.A. (Oxon)
 Kiwa Ltd. Technical Director

SUMMARY OF AGRÉMENT

This document provides independent information to specifiers, building control personnel, contractors, installers and other construction industry professionals considering the fitness for the intended use of the Product. This Agrément covers the following:

- Conditions of use;
- Production Control, Quality Management System and the Annual Verification procedure;
- Product components and ancillary items, points of attention for the Specifier and examples of details;
- Installation;
- Independently assessed Product characteristics and other information;
- Compliance with national Building Regulations, other regulatory requirements and Third-Party Acceptance, as appropriate;
- Sources.

MAJOR POINTS OF ASSESSMENT

Moisture Control - the Product can contribute to limiting the risk of interstitial and surface condensation (see section 2.2.9).

Fire Performance - the Product is classified as European Classification E* (combustible), in accordance with BS EN 13501-1 (see section 2.2.10).

Thermal Performance - the Product increases the thermal insulation of a flat roof structure (see section 2.2.11).

Durability - the Product will have a service life durability equivalent to that of the structure into which it is incorporated (see section 2.2.12).

CE Marking - the Agrément holder has responsibility for CE marking in accordance with all relevant harmonised European Product Standards. An asterisk (*) appearing in this Agrément indicates value included in the Declaration of Performance (DoP) (see section 2.2.13).

CONTENTS

Chapter 1 - General considerations

- 1.1 - Conditions of use
- 1.2 - Production Control and Quality Management System
- 1.3 - Annual verification procedure - continuous surveillance

Chapter 2 - Technical assessment

- 2.1 - Product components and ancillary items
- 2.2 - Points of attention to the Specifier
- 2.3 - Examples of details
- 2.4 - Installation
- 2.5 - Independently assessed Product characteristics

Chapter 3 - CDM, national Building Regulations and Third-Party Acceptance

- 3.1 - The Construction (Design and Management) Regulations 2015 and The Construction (Design and Management) Regulations (Northern Ireland) 2016
- 3.2 - The national Building Regulations
- 3.3 - Third-Party Acceptance

Chapter 4 - Sources

Chapter 5 - Amendment history

CHAPTER 1 - GENERAL CONSIDERATIONS

1.1 - CONDITIONS OF USE

1.1.1 Design considerations

See section 2.1.

1.1.2 Application

The assessment of the Product relates to its use in accordance with this Agrément and the Agrément holder's requirements.

1.1.3 Assessment

Kiwa Ltd. has assessed the Product in combination with relevant test reports, technical literature, the Agrément holder's quality plan, DoPs and site visit as appropriate. The NHBC Standards have also been taken into consideration.

1.1.4 Installation supervision

The quality of installation and workmanship must be controlled by a competent person who must be an employee of the installation company.

The Product must be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

1.1.5 Geographical scope

The validity of this document is limited to England, Wales, Scotland and Northern Ireland, with due regard to chapter 3 of this Agrément (CDM, national Building Regulations and Third-Party Acceptance).

1.1.6 Validity

The purpose of this BDA Agrément® is to provide for well-founded confidence to apply the Product within the Scope described. The validity of this Agrément is three years after the issue date, and as published on www.kiwa.co.uk/bda.

1.2 - PRODUCTION CONTROL AND QUALITY MANAGEMENT SYSTEM

Kiwa Ltd. has determined that the Agrément holder fulfils all obligations in relation to this Agrément, in respect of the Product.

The initial audit demonstrated that the Agrément holder has a satisfactory Quality Management System (QMS) and is committed to continuously improving their quality plan. Document control and record keeping procedures were deemed satisfactory. A detailed Production Quality Specification (PQS) has been compiled to ensure traceability and compliance under the terms of this Agrément.

1.3 - ANNUAL VERIFICATION PROCEDURE - CONTINUOUS SURVEILLANCE

To demonstrate that the Product is in conformity with the requirements of the technical specification described in this Agrément, an Annual Verification procedure has been agreed with the Agrément holder in respect of continuous surveillance and assessment, and auditing of the Agrément holder's QMS.

This Agrément does not constitute a design guide for the Product. It is intended as an assessment of fitness for purpose only.

2.1 - PRODUCT COMPONENTS AND ANCILLARY ITEMS

2.1.1 Product components included within the scope of this Agrément

The following components are integral to the use of the Product:

Item	Description	Dimensions
SuperQuilt	multi-foil thermal insulation and VCL	1.5 m wide by 10 m long by 40 mm (mean) thick providing 15 m ² coverage
		1.5 m wide by 5 m long by 40 mm (mean) thick providing 7.5 m ² coverage
		1.5 m wide by 2.4 m long by 40 mm (mean) thick providing 3.6 m ² coverage
		1.2 m wide by 10 m long by 40 mm (mean) thick providing 12 m ² coverage
		800 g/m ² (mean) weight
YBS Foil Tape	aluminium foil-backed acrylic self-adhesive tape	75 mm wide by 50 m long rolls

2.1.2 Ancillary items falling outside the scope of this Agrément

Ancillary items detailed in this section may be used in conjunction with the Product but fall outside the scope of this Agrément:

- staples or nails - stainless steel or galvanised steel, minimum 14 mm long;
- battens - pre-treated timber battens;
- YBS saddle clips - saddle clips;
- additional insulation - including glass mineral wool (GMW); expanded polystyrene (EPS); extruded polystyrene (XPS); polyisocyanurate (PIR); phenolic; sheep's wool; or polyester fibre insulation (YBS Non-Itch);
- roof void vents - plastic vents to provide cavity ventilation.

2.2 - POINTS OF ATTENTION TO THE SPECIFIER

2.2.1 Design responsibility

A Specifier may undertake a project specific design in which case it is recommended that the Specifier co-operates closely with the Agrément holder. The Specifier or installing contractor is responsible for the final as-built design.

2.2.2 Applied building physics (heat, air, moisture)

The physical behaviour of the building incorporating the Product shall be verified as suitable by a competent specialist, who can be either a qualified employee of the Agrément holder or a qualified consultant. The Specialist will check the physical behaviour of the building design and if necessary, can offer advice in respect of improvements to achieve the final specification. It is recommended that the Specialist co-operates closely with the Agrément holder.

2.2.3 General design considerations

Roof design considerations

Existing flat timber roofs shall be structurally sound, be in a good state of repair, and be free from any damp or mould.

New flat timber roofs shall be designed and constructed in accordance with the national Building Regulations to prevent moisture penetration and air infiltration.

Insulation batts or boards in a flat roof void shall meet the U-value requirement of the national Building Regulations.

The junction between a roof and wall shall be fire stopped. The minimum period of fire resistance of roof/wall junctions shall be maintained in accordance with the provisions of the national Building Regulations.

Account should be taken of:

- Government Accredited Construction Details for Part L - Timber Frame Illustrations in England and Wales;
- Accredited Construction Details for Scotland;
- PAS 2030; and
- PAS 2035.

Guidance on linear thermal transmittance, heat flows and surface temperatures can be found in the documents supporting the national Building Regulations and BS EN ISO 10211, BRE Information Paper IP 1/06, BRE Report 262 and BRE Report 497.

Thermal transmittance (U-value) calculations of specific flat roof constructions incorporating the Product should be carried out in accordance with BS EN ISO 6946, BS EN ISO 10211, and BRE Report 443. Design thermal values can be found in BS EN ISO 10456.

The requirement for limiting heat loss through a flat roof, including the effect of thermal bridging, can be satisfied if the U-value of a flat roof incorporating the Product does not exceed the target U-value requirement in the national Building Regulations.

The design and construction of junctions with walls and openings shall minimise air infiltration and thermal bridging. To minimise the effect of thermal bridging, cross-battening is advised.

Room space and roof void ventilation shall be in accordance with BS 5250. Care shall be taken to provide adequate trickle ventilation, particularly in rooms expected to experience high humidity.

Any ventilation openings should be sufficiently small or suitably protected by mesh to prevent the ingress of birds and small animals.

Any openings or penetrations in a flat ceiling and ceiling-wall joints shall be sealed to avoid condensation around the Product.

Product considerations

The Product can be cut using a sharp pair of scissors or craft knife.

The Product shall be cut to fit around openings or connections; gaps shall be minimised and any exposed cut edges shall be sealed using YBS Foil Tape.

Penetration of the Product by services should be kept to a minimum and shall be sealed using YBS Foil Tape.

For above timber joist applications, a plywood deck and waterproof covering shall be installed immediately after installation of the Product to protect it from rain.

When installed below timber joists, the installation of the Product is to be left until the finished roof is in place and any flue pipe openings are sealed.

At openings in a roof structure e.g. rooflights, the Product shall be supported by battens around the opening.

Where a plasterboard ceiling lining is installed to encapsulate the Product, it shall be designed and installed in accordance with BS 8212.

The Product shall be:

- suitably separated or shielded from any potential source of ignition during installation and once incorporated in a flat roof build-up;
- separated from any heat-producing chimney, ductwork or flue pipe penetrations of a flat roof, as recommended in the supporting documents to the national Building Regulations, and shall not be in contact with heat sources greater than 80 °C.

2.2.4 Project specific design considerations

No pre-installation survey is required for the installation of the Product.

A condensation risk analysis should be carried out at design stage in accordance with BS 5250 and BS EN ISO 13788 using an external temperature of -5 °C for 60 days during the heating season, to allow for the cooling effect of clear sky radiation.

2.2.5 Permitted applications

Only applications designed according to the specifications given in this Agrément are permitted; in each case the Specifier will have to co-operate closely with the Agrément holder.

2.2.6 Installer competence level

The Product must be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

Installation can be undertaken by competent persons experienced in this sort of work.

2.2.7 Delivery, storage and site handling

The Product is delivered to site in suitable packaging, that bears the Product name, the Agrément holder's name and the BDA Agrément® logo incorporating the number of this Agrément.

Store the Product in accordance with the Agrément holder's requirements. Particular care must be taken to:

- avoid exposure to direct sunlight for extended periods of time;
- avoid exposure to high or low temperatures for extended periods of time;
- store in a well-ventilated covered area to protect from rain, frost and humidity;
- store away from possible ignition sources;
- store in clean dry conditions;
- protect from being dropped or crushed;
- store away from flammable material, organic solvents and plasticisers;
- protect from mud and dirt.

For longer term protection on-site, the Product should be stored indoors.

Contaminated or wet Product shall not be used.

2.2.8 Maintenance and repair

Once installed, the Product does not require maintenance. The external flat roof finish shall be maintained in a weathertight condition.

Holes in the Product can be repaired using YBS Foil Tape. For advice in respect of repair, consult the Agrément holder.

Performance factors in relation to the Major Points of Assessment

2.2.9 Moisture control

Condensation risk

Flat timber roofs incorporating the Product will adequately limit the risk of interstitial and surface condensation when designed in accordance with BS 5250 and BRE Report 262.

Cold flat roofs incorporating the Product shall be designed in accordance with BS 6229 and BS 5250 and shall have:

- an effective air and vapour control layer at ceiling level;
- an unobstructed minimum 50 mm ventilation space above the insulation;
- adequate cross ventilation (openings at both ends of each joist void equivalent to a minimum 25 mm gap);
- a maximum clear distance of 5 m between ventilators on opposite sides of the roof.

In cold roofs incorporating the Product, the additional ventilation to the void(s) between the Product (with or without additional insulation) and decking can assist in removing water vapour from within the construction, in accordance with NHBC Standards.

2.2.10 Fire performance

The Product is classified as European Classification E* (combustible), in accordance with BS EN 13501-1.

The Product has a low rate of heat release and a low rate of fire growth when ignited. The Product will melt and shrink away from heat.

When the Product is:

- left exposed, it may contribute to an existing fire hazard;
- contained within a roof void, it will not contribute to the development stages of a fire or present a smoke or toxic hazard.

The Product does not:

- prejudice the fire resistance of a flat roof;
- affect the external fire exposure classification obtained by flat roofs in accordance with BS 476-3.

2.2.11 Thermal performance

The Product has a low hemispherical emissivity surface, in accordance with BS EN 16012 Annex D.

The thermal resistance of the Product has been declared in accordance with BS EN 16012 method B and BS EN 12667.

The Product acts by creating a low emissivity surface in a roof, thus reflecting heat back into a building.

The Product is effective:

- in improving the thermal insulation of flat timber roofs and helps to reduce energy transfer by conduction, convection and radiation;
- in winter by reflecting heat back into a building;
- in summer by providing an effective barrier to solar over-heating.

The Product reduces air leakage when joints are sealed using YBS Foil Tape.

2.2.12 Durability

The Product will have a service life durability equivalent to that of the structure into which it is incorporated.

The expected lifespan of the building itself should be at least 60 years.

The Product is stable, rot-proof, non-hygroscopic, water-resistant, inert, non-toxic, does not sustain vermin or insects and will not encourage the growth of fungi or mould.

The Product is coated with nitrocellulose to provide a corrosion-resistant surface.

Once installed, the Product is protected in service from agents liable to cause deterioration.

2.2.13 CE Marking

The harmonised European standards for the Product are Draft BS EN 16863 and BS EN 13984.

2.3 - EXAMPLES OF TYPICAL DETAILS

Diagram 1 - single layer - over joist

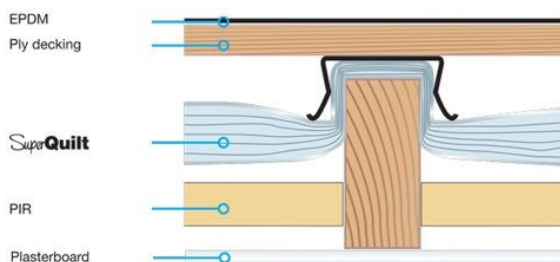


Diagram 2 - single layer - under joist, no battens

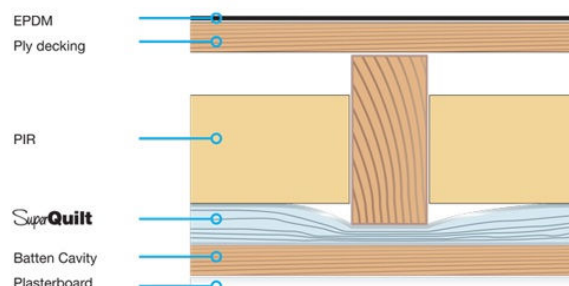


Diagram 3 - single layer - under joist, battens


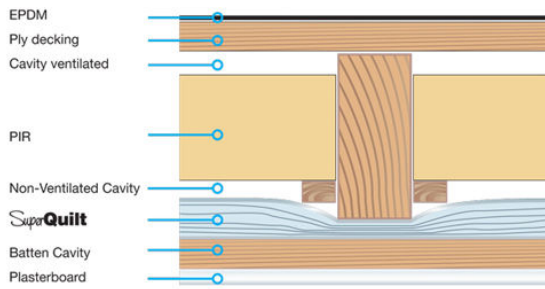


Diagram 4 - double layer - over and under joist

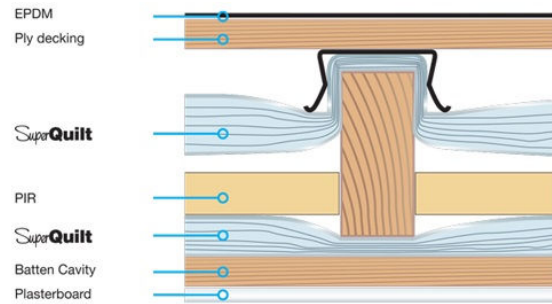

2.4 - INSTALLATION

The Product must be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

2.4.1 Installer competence level

See section 2.2.6.

2.4.2 Delivery, storage and site handling

See section 2.2.7.

2.4.3 Project specific installation considerations

No pre-installation survey is required for the installation of the Product.

2.4.4 Preparation

The following factors shall be considered prior to the commencement of work:

- ensure that sufficient material is available for the planned work.

2.4.5 Outline installation procedure

The key sequence for installation is:

- install the Product perpendicular to the joists, directly from the roll;
- start from external wall and fix using staples, nails or saddle clips;
- cut the Product equal to the width of the roof section plus 100 mm;
- overlap the Product at each joint by approximately 50 mm and fix onto the joists (the joints shall be sealed using YBS Foil Tape);
- at the eaves, cut the Product around the joists and seal to either solid cavity wall insulation or a wall plate.

2.4.6 Finishing

There is no finishing required to the Product upon completion of the installation.

2.5 - INDEPENDENTLY ASSESSED PRODUCT CHARACTERISTICS

2.5.1 Moisture control

Test	Result
Water vapour transmission resistance	1569 MNs/g*
Water vapour diffusion-equivalent air layer thickness (Sd)	313.8 m

2.5.2 Strength

Test	Result	
Tensile strength parallel to faces, in accordance with BS EN 1608	142 kPa*	
Resistance to tearing (nail shank), in accordance with BS EN 12310-1	Length	406 N*
	Width	411 N*
Dimensional stability under specified temperature and humidity, in accordance with BS EN 1604	Length	1.5 %
	Width	2.3 %

2.5.3 Fire performance

Test	Result
Reaction to fire classification, in accordance with BS EN 13501-1	E* (combustible)

2.5.4 Thermal performance

Test	Result	
Hemispherical emissivity coefficient of foil outer faces, in accordance with BS EN 16012 Annex D	0.02*	
Thermal resistance of Product core, in accordance with BS EN 16012 method B and BS EN 12667	1.52 m ² K/W*	
Thermal conductivity, in accordance with BS EN 16012	0.0283 W/mK	
Thermal resistance of Product compressed core, in accordance with BS EN 12667	7 mm thickness	0.23 m ² K/W
	14 mm thickness	0.47 m ² K/W
Calculated thermal resistance, in accordance with BS EN ISO 6946	Product with adjacent minimum 13 mm non-ventilated air cavities, vertical heat flow	2.5 m ² K/W*

CHAPTER 3 - CDM, NATIONAL BUILDING REGULATIONS AND THIRD-PARTY ACCEPTANCE

3.1 - THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS 2015 AND THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS (NORTHERN IRELAND) 2016

Information in this Agrément may assist the client, Principal Designer/CDM co-ordinator, designer and contractors to address their obligations under these Regulations.

3.2 - THE NATIONAL BUILDING REGULATIONS

In the opinion of Kiwa Ltd., the Product, if installed and used in accordance with Chapter 2 of this Agrément, can satisfy or contribute to satisfying the relevant requirements of the following national Building Regulations.

3.2.1 - ENGLAND THE BUILDING REGULATIONS 2010 AND SUBSEQUENT AMENDMENTS

- C2(c) Resistance to moisture - the Product can contribute to limiting the risk of surface and interstitial condensation
- J4 Protection of the building - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- L1(a)(i) Conservation of fuel and power - the Product can contribute to satisfying this Requirement
- Regulation 7 Materials and workmanship - the Product is manufactured from suitably safe and durable materials for its application and can be installed to give satisfactory performance
- Regulation 23 Requirements relating to thermal elements - the Product can contribute to a building envelope complying with the requirements of L1(a)(i)
- Regulation 26 CO₂ emission rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26A Fabric energy efficiency rates for new buildings - the Product can contribute to satisfying this Regulation

3.2.2 - WALES THE BUILDING REGULATIONS 2010 AND SUBSEQUENT AMENDMENTS

- C2(c) Resistance to moisture - the Product can contribute to limiting the risk of surface and interstitial condensation
- J4 Protection of the building - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- L1(a) Conservation of fuel and power - the Product can contribute to satisfying this Requirement
- Regulation 7 Materials and workmanship - the Product is manufactured from suitably safe and durable materials for its application and can be installed to give satisfactory performance
- Regulation 23 Requirements relating to thermal elements - the Product can contribute to a building envelope complying with the requirements of L1(a)(i)
- Regulation 26 CO₂ emission rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26A Primary energy consumption rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26B Fabric performance values for new dwellings - the Product can contribute to satisfying this Regulation

3.2.3 - SCOTLAND THE BUILDING (SCOTLAND) REGULATIONS 2004 AND SUBSEQUENT AMENDMENTS

3.2.3.1 Regulations 8 (1)(2) Durability, workmanship and fitness of materials

- The Product is manufactured from acceptable materials and is adequately resistant to deterioration and wear under normal service conditions, provided it is installed in accordance with the requirements of this Agrément

3.2.3.2 Regulation 9 Building Standards - Construction

- 2.3 Structural protection - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- 3.15 Condensation - a flat roof incorporating the Product can protect a building from moisture caused by surface or interstitial condensation
- 3.19 Combustion appliances - relationship to combustible materials - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- 6.1(b) Carbon dioxide emissions - the Product can contribute to satisfying this Requirement
- 6.2 Building insulation envelope - the Product can contribute to satisfying this Requirement
- 7.1(a)(b) Statement of sustainability - the Product can contribute to satisfying the relevant Requirements of Regulation 9, Standards 1 to 6, and therefore can contribute to a construction meeting a bronze level of sustainability as defined in this Standard; in addition, the Product can contribute to a construction meeting a higher level of sustainability as defined in this Standard

3.2.3.3 Regulation 12 Building Standards - Conversions

- all comments given under Regulation 9 also apply to this Regulation, with reference to Schedule 6 of the Building (Scotland) Regulations 2004 and subsequent amendments, clause 0.12 of the Technical Handbook (Domestic) and clause 0.12 of the Technical Handbook (Non-Domestic)

3.2.4 - NORTHERN IRELAND

THE BUILDING REGULATIONS (NORTHERN IRELAND) 2012 AND SUBSEQUENT AMENDMENTS

- 23(a)(i)(iii)(b) Fitness of materials and workmanship - the Product is manufactured from materials which are considered suitably safe and acceptable for use as thermal insulation
- 29 Condensation - the Product can contribute to protecting a building from moisture in the form of interstitial condensation
- 39(a)(i) Conservation measures - the Product can contribute to limiting heat gains and losses through a flat roof
- 40(2) Target carbon dioxide emission rates - a flat roof incorporating the Product must be designed and constructed as not to exceed its target CO₂ emission rate
- 43 Renovation of thermal elements - the renovation work carried out can ensure that a flat roof complies with Requirement 39(a)(i)
- 73(1)(b) Protection of people and buildings - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire

3.3 - THIRD-PARTY ACCEPTANCE

NHBC - In the opinion of Kiwa Ltd., the Product, if installed, used and maintained in accordance with this Agrément, can satisfy or contribute to satisfying the relevant requirements in relation to NHBC Standards, Chapter 7.1 Flat roofs and balconies.

CHAPTER 4 - SOURCES

- BS EN ISO 6946:2017 Building components and building elements. Thermal resistance and thermal transmittance. Calculation methods
- BS EN ISO 10211:2017 Thermal bridges in building construction. Heat flows and surface temperatures. Detailed calculations
- BS EN ISO 10456:2007 Building materials and products. Hygrothermal properties. Tabulated design values and procedures for determining declared and design thermal values
- BS EN ISO 13788:2012 Hygrothermal performance of building components and building elements. Internal surface temperature to avoid critical surface humidity and interstitial condensation. Calculation methods
- BS EN 1604:2013 Thermal insulating products for building applications. Determination of dimensional stability under specified temperature and humidity conditions
- BS EN 1608:2013 Thermal insulating products for building applications. Determination of tensile strength parallel to faces
- BS EN 12310-1:2000 Flexible sheets for waterproofing. Determination of resistance to tearing (nail shank). Bitumen sheets for roof waterproofing
- BS EN 12667:2001 Thermal performance of building materials and products. Determination of thermal resistance by means of guarded hot plate and heat flow meter methods. Products of high and medium thermal resistance
- BS EN 13501-1:2018 Fire classification of construction products and building elements. Classification using data from reaction to fire tests
- BS EN 13984:2013 Flexible sheets for waterproofing - Plastic and rubber vapour control layers - Definitions and characteristics
- BS EN 16012:2012+A1:2015 Thermal insulation for buildings. Reflective insulation products. Determination of the declared thermal performance
- Draft BS EN 16863 Thermal insulation products for buildings. Factory made reflective insulation products (RI). Specification
- BS 476-3:2004 Fire tests on building materials and structures. Classification and method of test for external fire exposure to roofs
- BS 5250:2011+A1:2016 Code of practice for control of condensation in buildings
- BS 6229:2018 Flat roofs with continuously supported flexible waterproof coverings. Code of practice
- BS 8212:1995 Code of practice for dry lining and partitioning using gypsum plasterboard
- Accredited Construction Details (Scotland) - Part 3 Timber frame construction details:2015
- BRE Information Paper IP 1/06:2006 Assessing the effects of thermal bridging at junctions and around openings
- BRE Report 262:2002 Thermal insulation: avoiding risks
- BRE Report 443:2006 Conventions for U-value calculations
- BRE Report 497:2007 Conventions for Calculating Linear thermal transmittance and Temperature Factors
- Government Accredited Construction Details for Part L:2019 - Timber Frame Illustrations
- NHBC Standards:2020
- PAS 2030:2019 Specification for the installation of energy efficiency measures in existing dwellings and insulation in residential park homes
- PAS 2035:2019 Retrofitting dwellings for improved energy efficiency. Specification and guidance

Remark: apart from these sources, technical information and confidential reports have been assessed; any relevant documents are in the possession of Kiwa Ltd. and kept in the Technical Assessment File of this Agrément. The Installation Manual for the Product may be subject to change, the Agrément holder should be contacted for clarification of revision.

CHAPTER 5 - AMENDMENT HISTORY

Revision	Amendment Description	Amended By	Approved By	Date
-	Draft for internal review	S Lloyd	P Oakley	May 2018
A	Issue for Client review	S Lloyd	P Oakley	May 2018
B	Issue for internal review	P Oakley	C Forshaw	September 2018
C	First issue	P Oakley	C Forshaw	September 2018
D	2021 SuperQuilt renewal	C Devine	C Vurley	August 2021



Kiwa Ltd.
 Unit 5 Prime Park Way
 Prime Enterprise Park
 Derby
 DE1 3QB
 T: +44 (0)1332 383333
 E: uk.bpenquiries@kiwa.com
 W: www.kiwa.co.uk/bda

BAW-19-112-P-A-UK
BDA Agrément®
SuperQuilt
Thermal Insulation Layer
(Wall Applications)

YBS Insulation Ltd.
 Unit 1 Craggs Industrial Park
 Morven Street
 Creswell
 Derbyshire
 S80 4AJ
 T: +44 (0)1909 721662
 E: technical@ybsinsulation.com
 W: www.ybsinsulation.com

SCOPE OF AGRÉMENT

This Agrément relates to SuperQuilt (hereinafter the 'Product'). The Product is for use as a flexible thermal insulation layer used in conjunction with additional insulation materials or on its own. The Product can be installed in masonry cavity walls, behind discontinuous weather resistant cladding on solid walls, behind dry-lining on masonry walls and on the inside of timber framed walls with outer brick leaf. The Product can also be installed on the inside of timber frame walls with outer brick, block, cladding or render board/render. When installed with overlaps sealed using YBS Foil Tape, the Product will perform as a vapour control layer (hereinafter 'VCL'). The Product can be used in new or existing domestic buildings, and non-domestic buildings with similar temperature and humidity conditions.

PRODUCT DESCRIPTION

The Product is a multi-foil insulation blanket consisting of 19 layers. The layers include polyester fibre wadding, expanded polyethylene (PE) closed cell foam, and aluminium foil coated polyethylene terephthalate (PET) film. The Product is faced with aluminium foil laminate with polyethylene backing and reinforcing glass-fibre scrim (Foil-Tec Single). The Product is manufactured in accordance with the requirements of BS EN 13984 (Product Type A) and Draft BS EN 16863. For use with YBS Foil Tape to seal joints and penetrations of the Product.

PRODUCT ILLUSTRATION



THIRD-PARTY ACCEPTANCE

NHBC - for detailed information see section 3.3 (Third-Party Acceptance).

STATEMENT

It is the opinion of Kiwa Ltd., that the Product is fit for its intended use, provided it is specified, installed and used in accordance with this Agrément.

Chris Vurley, CEng
 Technical Manager, Building Products

Mark Crowther, M.A. (Oxon)
 Kiwa Ltd. Technical Director

SUMMARY OF AGRÉMENT

This document provides independent information to specifiers, building control personnel, contractors, installers and other construction industry professionals considering the fitness for the intended use of the Product. This Agrément covers the following:

- Conditions of use;
- Production Control, Quality Management System and the Annual Verification procedure;
- Product components and ancillary items, points of attention for the Specifier and examples of details;
- Installation;
- Independently assessed Product characteristics and other information;
- Compliance with national Building Regulations, other regulatory requirements and Third-Party Acceptance, as appropriate;
- Sources.

MAJOR POINTS OF ASSESSMENT

Moisture Control - the Product can contribute to limiting the risk of interstitial and surface condensation (see section 2.2.9).

Fire Performance - the Product is classified as European Classification E* (combustible), in accordance with BS EN 13501-1 (see section 2.2.10).

Thermal Performance - the Product increases the thermal insulation of an external wall structure (see section 2.2.11).

Durability - the Product will have a service life durability equivalent to that of the structure into which it is incorporated (see section 2.2.12).

CE Marking - the Agrément holder has responsibility for CE marking in accordance with all relevant harmonised European Product Standards. An asterisk (*) appearing in this Agrément indicates value included in the Declaration of Performance (DoP) (see section 2.2.13).

CONTENTS

Chapter 1 - General considerations

- 1.1 - Conditions of use
- 1.2 - Production Control and Quality Management System
- 1.3 - Annual verification procedure - continuous surveillance

Chapter 2 - Technical assessment

- 2.1 - Product components and ancillary items
- 2.2 - Points of attention to the Specifier
- 2.3 - Examples of details
- 2.4 - Installation
- 2.5 - Independently assessed Product characteristics

Chapter 3 - CDM, national Building Regulations and Third-Party Acceptance

- 3.1 - The Construction (Design and Management) Regulations 2015 and The Construction (Design and Management) Regulations (Northern Ireland) 2016
- 3.2 - The national Building Regulations
- 3.3 - Third-Party Acceptance

Chapter 4 - Sources

Chapter 5 - Amendment history

CHAPTER 1 - GENERAL CONSIDERATIONS

1.1 - CONDITIONS OF USE

1.1.1 Design considerations

See section 2.1.

1.1.2 Application

The assessment of the Product relates to its use in accordance with this Agrément and the Agrément holder's requirements.

1.1.3 Assessment

Kiwa Ltd. has assessed the Product in combination with relevant test reports, technical literature, the Agrément holder's quality plan, DoPs and site visit as appropriate. The NHBC Standards have also been taken into consideration.

1.1.4 Installation supervision

The quality of installation and workmanship must be controlled by a competent person who must be an employee of the installation company.

The Product must be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

1.1.5 Geographical scope

The validity of this document is limited to England, Wales, Scotland and Northern Ireland, with due regard to chapter 3 of this Agrément (CDM, national Building Regulations and Third-Party Acceptance).

1.1.6 Validity

The purpose of this BDA Agrément® is to provide for well-founded confidence to apply the Product within the Scope described. The validity of this Agrément is three years after the issue date, and as published on www.kiwa.co.uk/bda.

1.2 - PRODUCTION CONTROL AND QUALITY MANAGEMENT SYSTEM

Kiwa Ltd. has determined that the Agrément holder fulfils all obligations in relation to this Agrément, in respect of the Product.

The initial audit demonstrated that the Agrément holder has a satisfactory Quality Management System (QMS) and is committed to continuously improving their quality plan. Document control and record keeping procedures were deemed satisfactory. A detailed Production Quality Specification (PQS) has been compiled to ensure traceability and compliance under the terms of this Agrément.

1.3 - ANNUAL VERIFICATION PROCEDURE - CONTINUOUS SURVEILLANCE

To demonstrate that the Product is in conformity with the requirements of the technical specification described in this Agrément, an Annual Verification procedure has been agreed with the Agrément holder in respect of continuous surveillance and assessment, and auditing of the Agrément holder's QMS.

This Agrément does not constitute a design guide for the Product. It is intended as an assessment of fitness for purpose only.

2.1 - PRODUCT COMPONENTS AND ANCILLARY ITEMS

2.1.1 Product components included within the scope of this Agrément

The following components are integral to the use of the Product:

Item	Description	Dimensions
SuperQuilt	multi-foil thermal insulation and VCL	1.5 m wide by 10 m long by 40 mm (mean) thick rolls providing 15 m ² coverage
		1.5 m wide by 5 m long by 40 mm (mean) thick rolls providing 7.5 m ² coverage
		1.5 m wide by 2.4 m long by 40 mm (mean) thick rolls providing 3.6 m ² coverage
		1.2 m wide by 10 m long by 40 mm (mean) thick rolls providing 12 m ² coverage
		800 g/m ² (mean) weight
YBS Foil Tape	aluminium foil-backed acrylic self-adhesive tape	75 mm wide by 50 m long rolls

2.1.2 Ancillary items falling outside the scope of this Agrément

Ancillary items detailed in this section may be used in conjunction with the Product but fall outside the scope of this Agrément:

- staples or nails - stainless steel or galvanised steel, minimum 14 mm long;
- spider clips;
- breather membrane;
- counter battens - pre-treated timber counter battens;
- additional insulation - including glass mineral wool (GMW); expanded polystyrene (EPS); extruded polystyrene (XPS); polyisocyanurate (PIR); phenolic; sheep's wool; or polyester fibre insulation (YBS Non-Itch);
- wall void vents - plastic vents to provide cavity ventilation.

2.2 - POINTS OF ATTENTION TO THE SPECIFIER

2.2.1 Design responsibility

A Specifier may undertake a project specific design in which case it is recommended that the Specifier co-operates closely with the Agrément holder. The Specifier or installing contractor is responsible for the final as-built design.

2.2.2 Applied building physics (heat, air, moisture)

The physical behaviour of the building incorporating the Product shall be verified as suitable by a competent specialist, who can be either a qualified employee of the Agrément holder or a qualified consultant. The Specialist will check the physical behaviour of the building design and if necessary, can offer advice in respect of improvements to achieve the final specification. It is recommended that the Specialist co-operates closely with the Agrément holder.

2.2.3 General design considerations

The uncompressed Product is most thermally effective with a minimum 13 mm or 20 mm non-ventilated air cavity (formed using timber battens, structural timbers (studs) or internal metal framing profile) on both sides of the Product.

Wall design considerations

Existing external walls shall be structurally sound, be in a good state of repair, and be free from any damp or mould.

New external walls shall be designed and constructed in accordance with the national Building Regulations to resist moisture penetration and air infiltration.

Timber framed walls with outer brick leaf and masonry cavity walls shall incorporate a clear cavity of 50 mm minimum width.

Consideration shall be given to the local wind-driven rain index and the site exposure zone according to BS 8104. In areas of very severe exposure in England and Wales, the NHBC require a residual cavity of minimum 75 mm where the outer leaf of a cavity wall is fair faced masonry.

A breather membrane should be installed on the external cold side of a sheathed timber frame wall with a brick or block outer leaf, cladding, render board/render or tile/slate hanging.

The surface of masonry cavity walls shall be free from loose material and large projections, with any holes filled and flush with the surface. Packing may be required to ensure a uniform plane for the battens to be fixed.

Insulation batts or boards in an external wall void will be required to meet the U-value requirement of the national Building Regulations.

Battens shall be positioned at the top and bottom of a wall and around the perimeter of windows and doors.

Timber battens shall either be naturally durable or, where necessary, be treated with preservative to give adequate resistance against decay and insect attack.

The junction between a wall and roof shall be fire stopped. The minimum period of fire resistance of wall/roof junctions shall be maintained in accordance with the provisions of the national Building Regulations.

Account should be taken of:

- Government Accredited Construction Details for Part L - Timber Frame Illustrations, Masonry Cavity Wall insulation details: Illustrations in England and Wales;

- Accredited Construction Details for Scotland;
- PAS 2030; and
- PAS 2035.

Guidance on linear thermal transmittance, heat flows and surface temperatures can be found in the documents supporting the national Building Regulations and BS EN ISO 10211, BRE Information Paper IP1/06, BRE Report 262 and BRE Report 497.

Thermal transmittance (U-value) calculations of specific wall constructions incorporating the Product should be carried out in accordance with BS EN ISO 6946, BS EN ISO 10211, and BRE Report 443. Design thermal values can be found in BS EN ISO 10456.

The requirement for limiting heat loss through an external wall, including the effect of thermal bridging, can be satisfied if the U-value of an external wall incorporating the Product does not exceed the target U-value requirement in the national Building Regulations.

The design and construction of junctions with roofs and openings shall minimise air infiltration and thermal bridging. To minimise the effect of thermal bridging cross-battening is advised.

Room space and wall void ventilation shall be in accordance with BS 5250. Care shall be taken to provide adequate trickle ventilation, particularly in rooms expected to experience high humidity.

Any ventilation openings should be sufficiently small or suitably protected by mesh to prevent the ingress of birds and small animals.

Any openings or penetrations in a wall/dry-lining plasterboard and wall-ceiling joints shall be well sealed to avoid condensation around the Product.

Product considerations

The Product can be cut using a sharp pair of scissors or craft knife.

The Product shall be cut to fit around openings or connections; gaps shall be minimised and any exposed cut edges shall be sealed using YBS Foil Tape.

Penetration of the Product by services should be kept to a minimum and shall be sealed using YBS Foil Tape.

When installed outside studs/battens, the outer brick leaf, cladding sarking board or wall hanging tiles/slates shall be installed immediately after installation of the Product to protect it from the rain.

Where a plasterboard wall lining is installed to encapsulate the Product, it shall be designed and installed in accordance with BS 8212.

The Product shall be:

- suitably separated from any potential source of ignition during installation and once incorporated in an external wall build-up;
- separated from any heat-producing chimney, ductwork or flue pipe penetrations of an external wall, as recommended in the supporting documents to the national Building Regulations, and shall not be in contact with heat sources greater than 80 °C.

2.2.4 Project specific design considerations

No pre-installation survey is required for the installation of the Product.

Due consideration shall be given to the need to conduct a condensation risk analysis in accordance with BS 5250 Annex G.

2.2.5 Permitted applications

Only applications designed according to the specifications given in this Agrément are permitted; in each case the Specifier will have to co-operate closely with the Agrément holder.

2.2.6 Installer competence level

The Product must be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

Installation can be undertaken by competent persons experienced in this sort of work.

2.2.7 Delivery, storage and site handling

The Product is delivered to site in suitable packaging, that bears the Product name, the Agrément holder's name and the BDA Agrément® logo incorporating the number of this Agrément.

Store the Product in accordance with the Agrément holder's requirements. Particular care must be taken to:

- avoid exposure to direct sunlight for extended periods of time;
- avoid exposure to high or low temperatures for extended periods of time;
- store in a well-ventilated covered area to protect from rain, frost and humidity;
- store away from possible ignition sources;
- store in clean dry conditions;
- protect from being dropped or crushed;
- store away from flammable material, organic solvents and plasticisers;
- protect from mud and dirt.

For longer term protection on-site, the Product should be stored indoors.

Contaminated or wet Product shall not be used.

2.2.8 Maintenance and repair

Once installed, the Product does not require maintenance. The external wall finish shall be maintained in a weathertight condition.

Holes in the Product can be repaired using YBS Foil Tape. For advice in respect of repair, consult the Agrément holder.

Performance factors in relation to the Major Points of Assessment

2.2.9 Moisture control

Condensation risk

External walls incorporating the Product will adequately limit the risk of interstitial and surface condensation when designed and constructed in accordance with BS 5250 Annex G and BRE Report 262.

The Product will perform as a VCL when installed with overlaps sealed using YBS Foil Tape.

2.2.10 Fire performance

The Product is classified as European Classification E* (combustible), in accordance with BS EN 13501-1.

The Product has a low rate of heat release and a low rate of fire growth when ignited. The Product will melt and shrink away from heat.

When the Product is:

- left exposed, it may contribute to an existing fire hazard;
- is contained within a wall cavity, the Product will not contribute to the development stages of a fire or present a smoke or toxic hazard.

The Product does not:

- impair the fire resistance of an external wall;
- affect the external fire exposure classification obtained by the external wall finish.

2.2.11 Thermal performance

The Product has a low hemispherical emissivity surface, in accordance with BS EN 16012 Annex D.

The thermal resistance of the Product has been declared in accordance with BS EN 16012 method B and BS EN 12667.

The Product acts by creating a low emissivity surface in a wall, thus reflecting heat back into a building.

The Product is effective:

- in improving the thermal insulation of external walls and helps to reduce energy transfer by conduction, convection and radiation
- in winter by reflecting heat back into a building;
- in summer by providing an effective barrier to solar over-heating.

The Product reduces air leakage when joints are sealed using YBS Foil Tape.

2.2.12 Durability

The Product will have a service life durability equivalent to that of the structure into which it is incorporated.

The expected lifespan of the building itself should be at least 60 years.

The Product is coated with nitrocellulose to provide a corrosion-resistant surface.

The Product is stable, rot-proof, non-hygroscopic, water-resistant, inert, non-toxic, does not sustain vermin or insects and will not encourage the growth of fungi or mould.

Once installed, the Product is protected in service from agents liable to cause deterioration.

2.2.13 CE Marking

The harmonised European standards for the Product are Draft BS EN 16863 and BS EN 13984.

2.3 - EXAMPLES OF TYPICAL DETAILS

Diagram 1 - masonry cavity wall application

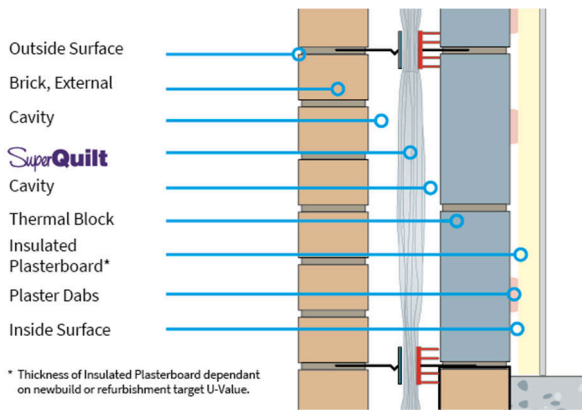


Diagram 2 - installation on solid masonry wall application

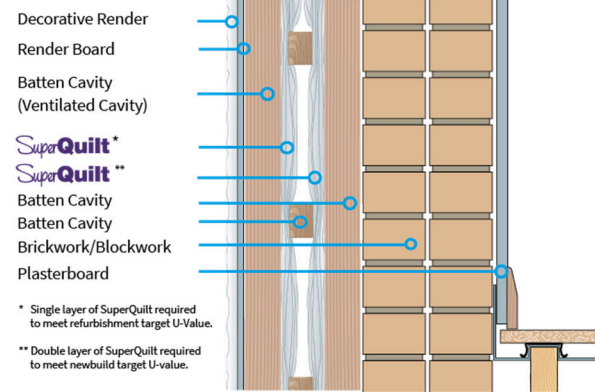


Diagram 3 - dry lining on masonry solid wall application


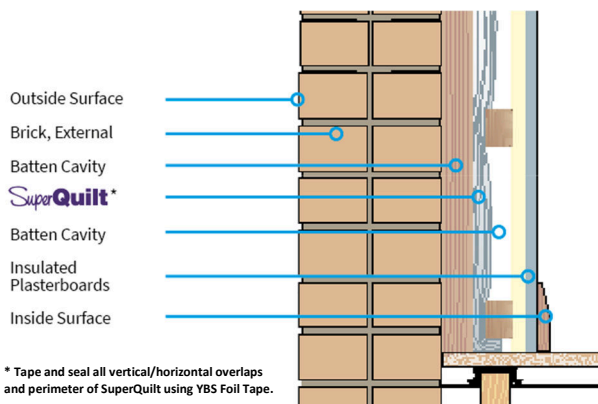


Diagram 4 - timber framed wall with outer brick leaf application

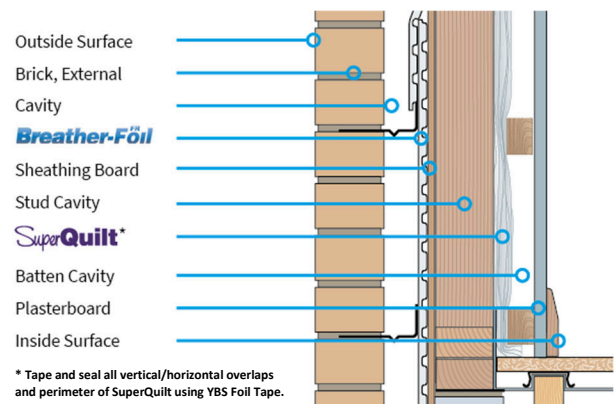

2.4 - INSTALLATION

The Product must be installed strictly in accordance with the instructions of the Agrément holder and the requirements of this Agrément.

2.4.1 Installer competence level

See section 2.2.6.

2.4.2 Delivery, storage and site handling

See section 2.2.7.

2.4.3 Project specific installation considerations

No pre-installation survey is required for the installation of the Product.

2.4.4 Preparation

The following factors shall be considered prior to the commencement of work:

- ensure that sufficient material is available for the planned work.

2.4.5 Outline installation procedure

The key sequence for installation is:

- fix vertical/horizontal counter battens (with minimum dimensions 25 mm by 38 mm) to a wall at 400 mm centres (shall always be placed at the top and bottom of a wall and around the perimeter of doors and windows);
- install the Product directly from the roll either vertically or horizontally depending on wall height, pulled tight and stapled or nailed on to the battens at minimum 400 mm centres (ensuring the reflective foil side of the Product is facing the cavity formed);
- overlap the Product at each joint by approximately 50 mm and staple onto the battens;
- tape and seal all overlaps using YBS Foil Tape.

2.4.6 Finishing

There is no finishing required to the Product upon completion of the installation.

2.5 - INDEPENDENTLY ASSESSED PRODUCT CHARACTERISTICS

2.5.1 Moisture control

Test	Result
Water vapour transmission resistance	1569 MNs/g*
Water vapour diffusion-equivalent air layer thickness (Sd)	313.8 m

2.5.2 Strength

Test	Result	
Tensile strength parallel to faces, in accordance with BS EN 1608	142 kPa*	
Resistance to tearing (nail shank), in accordance with BS EN 12310-1	Length	406 N*
	Width	411 N*
Dimensional stability under specified temperature and humidity, in accordance with BS EN 1604	Length	1.5 %
	Width	2.3 %

2.5.3 Fire performance

Test	Result
Reaction to fire classification, in accordance with BS EN 13501-1	E* (combustible)

2.5.4 Thermal performance

Test	Result	
Hemispherical emissivity coefficient of foil outer faces, in accordance with BS EN 16012 Annex D	0.02*	
Thermal resistance of Product core, in accordance with BS EN 16012 method B and BS EN 12667	1.52 m ² K/W*	
Thermal conductivity, in accordance with BS EN 16012	0.0283 W/mK	
Thermal resistance of Product compressed core, in accordance with BS EN 12667	7 mm thickness	0.23 m ² K/W
	14 mm thickness	0.47 m ² K/W
Calculated thermal resistance, in accordance with BS EN ISO 6946	Product with two adjacent minimum 13 mm non-ventilated cavities, horizontal heat flow	2.5 m ² K/W*
	Product with two adjacent minimum 20 mm non-ventilated cavities, horizontal heat flow	3.0 m ² K/W*

CHAPTER 3 - CDM, NATIONAL BUILDING REGULATIONS AND THIRD-PARTY ACCEPTANCE

3.1 - THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS 2015 AND THE CONSTRUCTION (DESIGN AND MANAGEMENT) REGULATIONS (NORTHERN IRELAND) 2016

Information in this Agrément may assist the client, Principal Designer/CDM co-ordinator, designer and contractors to address their obligations under these Regulations.

3.2 - THE NATIONAL BUILDING REGULATIONS

In the opinion of Kiwa Ltd., the Product, if installed and used in accordance with Chapter 2 of this Agrément, can satisfy or contribute to satisfying the relevant requirements of the following national Building Regulations.

3.2.1 - ENGLAND THE BUILDING REGULATIONS 2010 AND SUBSEQUENT AMENDMENTS

- C2(c) Resistance to moisture - the Product can contribute to limiting the risk of surface and interstitial condensation
- J4 Protection of the building - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- L1(a)(b) Conservation of fuel and power - the Product can contribute to satisfying this Requirement
- Regulation 7 Materials and workmanship - the Product is manufactured from suitably safe and durable materials for its application and can be installed to give satisfactory performance
- Regulation 23 Requirements relating to thermal elements - the use of the Product can contribute to the conservation of fuel and power in buildings by limiting heat gains and losses through external wall
- Regulation 25 Minimum energy performance Requirements for new buildings - the Product can contribute to the target CO₂ emission rates
- Regulation 26 CO₂ emission rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26A Fabric energy efficiency rates for new buildings - the Product can contribute to satisfying this Regulation

3.2.2 - WALES THE BUILDING REGULATIONS 2010 AND SUBSEQUENT AMENDMENTS

- C2(c) Resistance to moisture - the Product can contribute to limiting the risk of surface and interstitial condensation
- J4 Protection of the building - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- L1(a)(b) Conservation of fuel and power - the Product can contribute to satisfying this Requirement
- Regulation 7 Materials and workmanship - the Product is manufactured from suitably safe and durable materials for its application and can be installed to give satisfactory performance
- Regulation 23 Requirements relating to thermal elements - the use of the Product can contribute to the conservation of fuel and power in buildings by limiting heat gains and losses through external wall
- Regulation 25 Minimum energy performance Requirements for new buildings - the Product can contribute to the target CO₂ emission rates
- Regulation 26 CO₂ emission rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26A Primary energy consumption rates for new buildings - the Product can contribute to satisfying this Regulation
- Regulation 26B Fabric performance values for new dwellings - the Product can contribute to satisfying this Regulation

3.2.3 - SCOTLAND THE BUILDING (SCOTLAND) REGULATIONS 2004 AND SUBSEQUENT AMENDMENTS

3.2.3.1 Regulation 8 (1)(2) Durability, workmanship and fitness of materials

- the Product is manufactured from acceptable materials and is adequately resistant to deterioration and wear under normal service conditions, provided it is installed in accordance with the requirements of this Agrément

3.2.3.2 Regulation 9 Building Standards - Construction

- 2.3 Structural protection - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- 3.15 Condensation - envelope structures using the Product in accordance with the Requirements of this Agrément, can be designed and constructed to comply with these Standards
- 3.19 Combustion appliances - relationship to combustible materials - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire
- 6.1(b) Carbon dioxide emissions - the Product can contribute to satisfying this Requirement
- 6.2 Building insulation envelope - the Product can contribute to satisfying this Requirement
- 7.1(a)(b) Statement of sustainability - the Product can contribute to satisfying the relevant Requirements of Regulation 9, Standards 1 to 6, and therefore can contribute to a construction meeting a bronze level of sustainability as defined in this Standard; in addition, the Product can contribute to a construction meeting a higher level of sustainability as defined in this Standards

3.2.3.3 Regulation 12 Building Standards - Conversions

- all comments given under Regulation 9 also apply to this Regulation, with reference to Schedule 6 of the Building (Scotland) Regulations 2004 and subsequent amendments, clause 0.12 of the Technical Handbook (Domestic) and clause 0.12 of the Technical Handbook (Non-Domestic)

3.2.4 - NORTHERN IRELAND

THE BUILDING REGULATIONS (NORTHERN IRELAND) 2012 AND SUBSEQUENT AMENDMENTS

- 23(a)(i)(iii)(b) Fitness of materials and workmanship - the Product is manufactured from materials which are considered suitably safe and acceptable for use as thermal insulation
- 29 Condensation - the Product can contribute to limiting the risk of surface and interstitial condensation
- 39(a)(i) Conservation measures - the Product can contribute to limiting heat gains and losses through a wall
- 40(2) Target carbon dioxide emission rates - a wall incorporating the Product must be designed and constructed as not to exceed its target CO₂ emission rate
- 43 Renovation of thermal elements - the renovation work carried out can ensure that external wall complies with Requirement 39(a)(i)
- 73(1) Protection of people and buildings - the Product can be separated from heat producing appliances, flue pipes or chimneys to prevent a building from catching fire

3.3 - THIRD-PARTY ACCEPTANCE

NHBC - In the opinion of Kiwa Ltd., the Product, if installed, used and maintained in accordance with this Agrément, can satisfy or contribute to satisfying the relevant requirements in relation to NHBC Standards, Chapter 6.1 External masonry walls and Chapter 6.2 External timber framed walls.

CHAPTER 4 - SOURCES

- BS EN ISO 6946:2017 Building components and building elements. Thermal resistance and thermal transmittance. Calculation methods
- BS EN ISO 10211:2017 Thermal bridges in building construction. Heat flows and surface temperatures. Detailed calculations
- BS EN ISO 10456:2007 Building materials and products. Hygrothermal properties. Tabulated design values and procedures for determining declared and design thermal values
- BS EN 1604:2013 Thermal insulating products for building applications. Determination of dimensional stability under specified temperature and humidity conditions
- BS EN 1608:2013 Thermal insulating products for building applications. Determination of tensile strength parallel to faces
- BS EN 12310-1:2000 Flexible sheets for waterproofing. Determination of resistance to tearing (nail shank). Bitumen sheets for roof waterproofing
- BS EN 12667:2001 Thermal performance of building materials and products. Determination of thermal resistance by means of guarded hot plate and heat flow meter methods. Products of high and medium thermal resistance
- BS EN 13501-1:2018 Fire classification of construction products and building elements. Classification using data from reaction to fire tests
- BS EN 13984:2013 Flexible sheets for waterproofing. Plastic and rubber vapour control layers. Definitions and characteristics
- BS EN 16012:2012+A1:2015 Thermal insulation for buildings. Reflective insulation products. Determination of the declared thermal performance
- Draft BS EN 16863 Thermal insulation products for buildings. Factory made reflective insulation products (RI). Specification
- BS 5250:2011+A1:2016 Code of practice for control of condensation in buildings
- BS 8104:1992 Code of practice for assessing exposure of walls to wind-driven rain
- BS 8212:1995 Code of practice for dry lining and partitioning using gypsum plasterboard
- Accredited Construction Details (Scotland) - Part 3 Timber frame construction details:2015
- BRE Information Paper 1/06:2006 Assessing the effects of thermal bridging at junctions and around openings
- BRE Report 262:2002 Thermal insulation: avoiding risks
- BRE Report 443:2006 Conventions for U-value calculations
- BRE Report 497:2016 Conventions for Calculating Linear thermal transmittance and Temperature Factors
- Government Accredited Construction Details for Part L:2019
- NHBC Standards:2020
- PAS 2030:2019 Specification for the installation of energy efficiency measures in existing dwellings and insulation in residential park homes
- PAS 2035:2019 Retrofitting dwellings for improved energy efficiency. Specification and guidance

Remark: apart from these sources, technical information and confidential reports have been assessed; any relevant documents are in the possession of Kiwa Ltd. and kept in the Technical Assessment File of this Agrément. The Installation Manual for the Product may be subject to change, the Agrément holder should be contacted for clarification of revision.

CHAPTER 5 - AMENDMENT HISTORY

Revision	Amendment Description	Amended By	Approved By	Date
-	First Issue	C Devine	C Vurley	May 2021